

پترو فرهان گستر جنوب

Tehran, Tehransar

HIOKI

POWER QUALITY ANALYZER PQ3198, PQ3100



IEC61000-4-30 Ed. 3 Class S



Ver 2.00

Newly Added Functions

Now IEC61000-4-30 Ed. 3 Class A compliant!

Investigate power characteristics and analyze the causes of problems

Exceptional ease of use and international standard-compliant reliability

Maintain and manage power supplies and analyze problems more easily and reliably than ever before

POWER QUALITY ANALYZER PQ3198 and PQ3100

The critical importance of electrical power in today's society necessitates daily maintenance and management to ensure that problems don't occur. When they do, for example due to an equipment failure or abrupt surge in demand, engineers face the need to analyze the cause quickly.


The POWER QUALITY ANALYZER PQ3198 and PQ3100 provide robust support for field personnel who need to analyze power characteristics in the form of measurement capabilities that reliably captures the full range of power anomalies and exceptional ease of use throughout the entire user experience, from connecting the instrument to recording data.



IEC 61000-4-30 Ed. 3 compliant

IEC61000-4-30 is an international standard that specifies methods for measuring power supply quality. Equipment certified as complying with this standard provides reliable and repeatable measurement results.



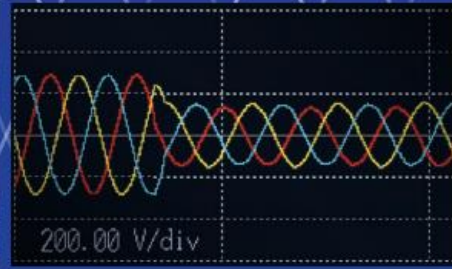

Analyze equipment power problems

Capture the full range of power supply anomalies, including momentary interruptions, voltage drops, and frequency fluctuations, while recording trends to help investigate the causes of unexpected equipment malfunctions and sudden stoppages.



Ures[V]	Ires[A]	Freq[Hz]
397.12	1	6.767 U1
399.91	2	15.375
401.25	3	17.300

	PIW	SIVA	Q[var]	PF
1	1.494k	1.560k	0.448k	0.9578
2	3.474k	3.576k	-0.847k	-0.9711
3	3.957k	4.006k	0.554k	0.9904
SUM	8.885k	9.100k	0.160k	-0.9764

Active energy WP+ 81.569k Wh
Elapsed time 11:51:34

Record quality data for power systems

Record fluctuations in voltage, current, power, harmonics, and flicker when connecting a highly variable system such as a renewable energy source or EV charging station to the grid. Easily analyze the data with the included PQ ONE software.



Measure AC/DC power

Use AC/DC auto-zero current sensors to measure DC current accurately over extended periods of time. Since the sensors are powered by the instrument, there's no need to set up a separate power supply.



Troubleshoot power supplies and verify power quality

PQ3198

Features

Class A compliance under international standards

Basic voltage measurement accuracy of $\pm 0.1\%$

High-voltage, wideband performance

Two-circuit measurement

Simple inverter measurement

400 Hz line measurement

GPS time synchronization

Extensive array of event measurement parameters



Applications



Investigate power supply anomalies

Investigate the causes of equipment failures and malfunctions, including issues that are difficult to identify, such as when a device causes a properly-functioning piece of equipment that is connected to the same power outlet to experience a voltage drop.



Verify the quality of power from a solar power system

Check fluctuations in the output voltage of a power conditioner in a solar power system along with flicker and transient voltages. You can also measure fluctuations in the frequency of the grid interconnection and fluctuations in the harmonic voltage and current components of the system's output.



Verify the quality of power supplied by an EV rapid charger

Since the PQ3198's fourth voltage channel is isolated from its first three voltage channels, the instrument can measure power and efficiency across two separate circuits. For example, you can verify the quality of the input (AC) and output (DC) of an EV rapid charger while simultaneously measuring power and efficiency between input and output.

High-precision, wideband, broad-dynamic-range measurement

The PQ3198 delivers the high-end specifications and high reliability needed to capture the full range of power anomalies and analyze the underlying data with a high degree of precision.

International standard IEC 61000-4-30 Ed. 3 Class A compliant



The PQ3198 complies with the IEC 61000-4-30 Ed. 3 Class A standard. As a result, it can perform standard-mandated measurement tasks such as gapless, continuous calculation; detection of events such as swells, dips, and interruptions; and time synchronization using GPS (optional).

Basic measurement accuracy (50/60 Hz)

Voltage	±0.1% of nominal voltage
Current	±0.1% rdg. ±0.1% f.s. + current sensor accuracy
Power	±0.2% rdg. ±0.1% f.s. + current sensor accuracy
Frequency	200ms: ±0.02Hz / 10s: ±0.003Hz


Thanks to basic measurement accuracy that is among the best of any instrument in the industry, the PQ3198 offers high-precision measurement without the need to switch voltage ranges.

Class A
Part of the IEC 61000-4-30 international standard, Class A defines power quality parameters, accuracy, and standard compliance to facilitate the comparison and discussion of measurement results from different instruments.

High-voltage, wideband performance


The PQ3198 can measure transient voltages of up to 6000 V lasting as little as 0.5 μs (2 MS/s). It can also measure high-order harmonic (supraharmonic) components from 2 kHz to 80 kHz. As inverters enter into widespread use, malfunctions and failures in that frequency band are becoming more common.

Voltage measurement range

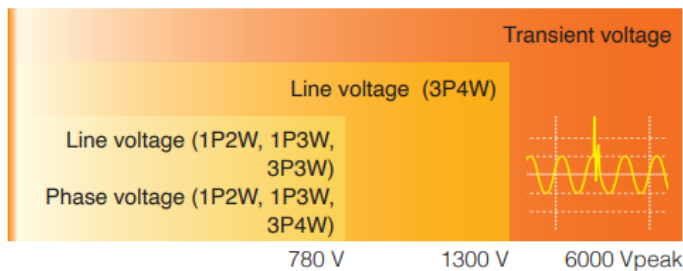

The PQ3198 can measure voltages of all magnitudes using a single range.

Voltage frequency band

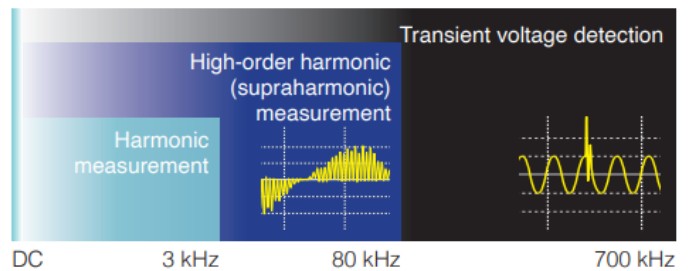

The PQ3198's wideband capability extends from DC voltages to 700 kHz.

Two-circuit measurement

Since the PQ3198's fourth voltage channel is isolated from its first three voltage channels, the instrument can measure power and efficiency across two separate circuits.

Applications

- Simultaneous measurement/monitoring of the primary (AC) and secondary (DC) sides of an EV rapid charger
- Simultaneous measurement/monitoring of the primary (DC) and secondary (AC) sides of a solar power system
- Simultaneous measurement of the primary (DC) and secondary (AC) sides of a DC/AC (3-phase) inverter
- Simultaneous measurement of the primary and secondary sides of a UPS
- Simultaneous measurement of power supply (AC) and control (DC) circuits
- Simultaneous measurement of a 3-phase line and a ground line
- Simultaneous measurement of a neutral line to detect ground

*For DC measurement, an AC/DC Auto-Zero Current Sensor is required




400 Hz line measurement

In addition to 50/60 Hz, the PQ3198 can measure a line frequency of 400 Hz.



Simple inverter measurement


The PQ3198 can measure the secondary side of inverters with a fundamental frequency of 40 to 70 Hz and a carrier frequency of up to 20 kHz. It can also measure the efficiency of DC/3-phase inverters.

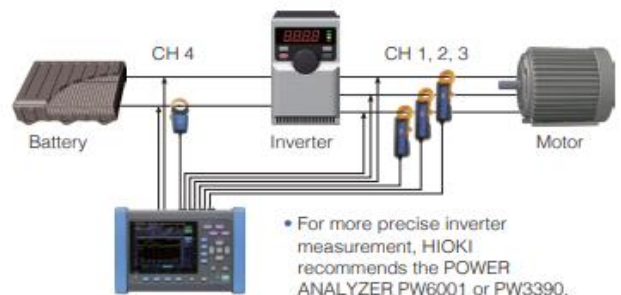

- For more precise inverter measurement, HIOKI recommends the POWER ANALYZER PW6001 or PW3390.

GPS time synchronization

The GPS OPTION PW9005 can be used to correct the instrument's internal time to UTC standard time. This capability eliminates any time difference between instruments to allow analysis that preserves the simultaneity of phenomena measured with multiple instruments.

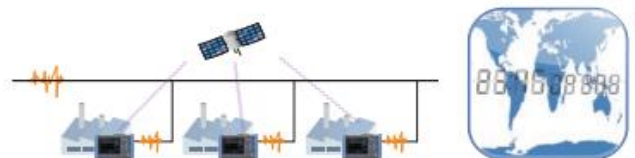

Investigate power supply conditions and prevent problems

PQ3100

Features

Simple setup with QUICK SET

Record event waveforms of up to 11 sec. in duration

8 hours of battery operation

200 ms and 600 ms data save capability

CAT III (1000 V)/CAT IV (600 V)

Display event statistics

Demand recording




Applications



Investigate power supply conditions

Measure voltage fluctuations, equipment capacity, and harmonics before installing new electrical equipment. You can also check whether newly installed equipment is affecting other equipment by repeating those measurements after installation and comparing the results.

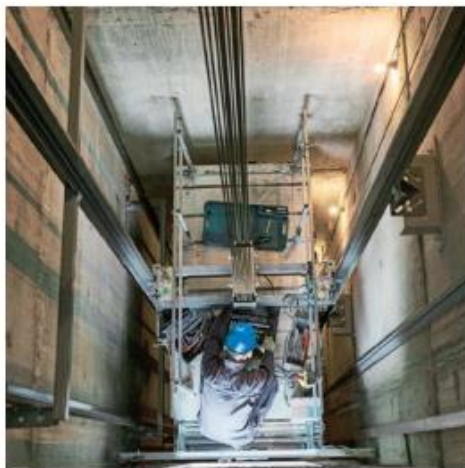

Prevent power supply problems

Discover signs of impending problems by repeatedly measuring a component such as an elevator motor on a regular basis. Flexible current sensors make it possible to connect the instrument safely and easily, even in difficult settings involving double wiring, busbars, and crowded distribution boards.



Perform load rejection testing of solar power systems

In load rejection testing, it's necessary to record transient changes in current and voltage when the system is taken offline. The PQ3100 can record anomalous waveforms for up to 11 seconds (1 second before and 10 after each event). Cursor measurement lets you verify peak values and duration as well.

QUICK SET: Easy-to-understand measurement guidance

Launch QUICK SET to navigate the connection and setup processes so you can get started recording quickly.


Setting up the instrument

(example: 2-meter power measurement of a 3-phase/3-wire circuit)

STEP 1 Choose the connection type and connect the cables to the instrument.



STEP 2 Connect the voltage cables and current sensors to the circuit to be measured.

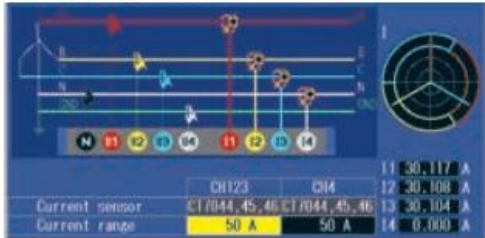

STEP 3 The instrument will perform an automatic wiring check and display the results.



Notification of what to fix in the event of a FAIL result

Fail: Phase difference

FAIL will display when each current phase is not w/in $\pm 90^\circ$ of each voltage phase.

- * Are Voltage leads and current sensors properly connected?
- * Is arrow of current sensor pointed to the lead?

CHECK will display when current phase is w/in $\pm 60^\circ$ to $\pm 90^\circ$ of each voltage phase.




For example, you won't be able to measure power or power factor accurately if the clamp is oriented incorrectly.

STEP 4 You need only set the recording parameters and interval in order to start measurement. Recording parameters can be set simply by choosing a simple setup preset. (See page 8 for details.)


Recording of 11 sec. before and after events

The PQ3100 can record waveforms for up to 1 second before an anomaly and 10 seconds after. This capability is useful when you need to analyze waveforms before and after an anomaly, perform load rejection testing of a solar power conditioner, or verify that a piece of equipment has returned to normal operation.

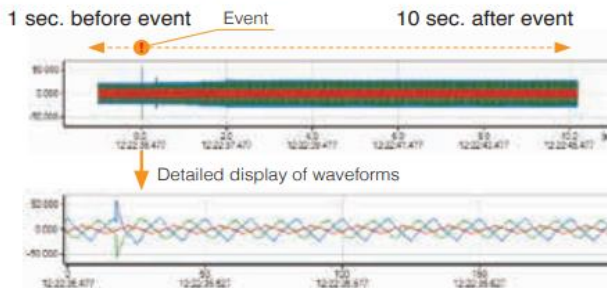

Display of event statistics

Check the number of times each type of event has occurred as well as the worst value for each.

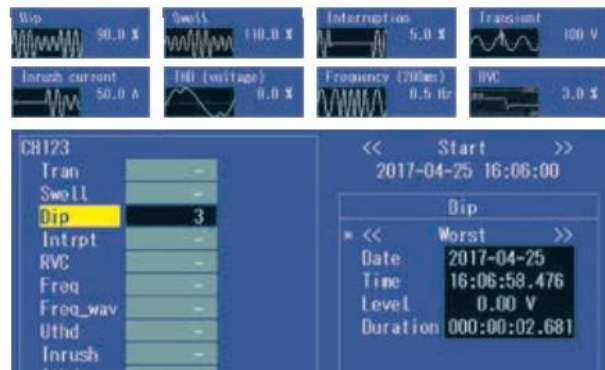

Up to 8 hours of battery operation

The PQ3100 features an energy-saving design and a long-lasting battery. The bundled rechargeable battery lets you continue measurement in the event of a power outage or take the instrument into the field to make measurements in locations where AC power is not available.



- Outdoors
- During power outages
- Extended operation

Demand recording


Record power consumption over time.



Measurement functionality and data recording capabilities that ensure you'll capture the full picture with a single measurement

Capture power anomalies reliably with simple settings


The PQ3198 and PQ3100 can measure all parameters at once, including power, harmonics, and anomaly waveforms. The instruments also provide simple setup functionality for automatically configuring recording parameters for popular applications.

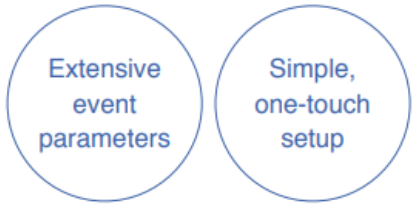

Capture power supply anomalies reliably


Transient voltages

Capture phenomena characterized by precipitous voltage changes and high peak values caused by lightning or circuit breaker or relay contact issues or tripping.




Voltage swells

Capture phenomena characterized by a momentary rise in voltage, for example due to lightning or power line switching.




Voltage dips

Capture phenomena characterized by a short-duration drop in voltage when a large inrush current occurs, for example due to motor startup.




Interruptions

Capture phenomena characterized by a stoppage in the supply of power, for example when lightning interrupts power or when a power supply short-circuit trips a circuit breaker.




Frequency fluctuations

Capture frequency fluctuations caused when generator operation becomes unstable due to an abrupt increase or decrease in load.




Inrush current

Capture phenomena characterized by a large current that flows momentarily when a device starts up upon receiving power, for example electric equipment and motors.




Harmonics

Capture phenomena characterized by distortions in voltage and current waveforms that are caused by semiconductor control devices.




High-order harmonics

Capture phenomena characterized by distortions in voltage and current waveforms caused by noise components from semiconductor control devices such as those used in electronic device power supplies.



Unbalance

Observe voltage and current waveform distortion, voltage dips, and negative-phase-sequence voltage that occur when the loads connected to individual phases in a 3-phase power supply change or when unstable equipment operation increases the load on a specific phase.



Simple, one-touch setup

Simple setup functionality for simplified configuration of recording parameters

Simply choose the preset that suits your application, and the instrument will automatically configure the recording parameters.

Voltage anomaly detection	Capture voltage and frequency anomalies.
Basic power quality measurement^{*1}	Augment the voltage anomaly detection preset by capturing current and harmonic anomalies as well.
Inrush current measurement	Capture inrush current.
Measured value recording^{*2}	Record only time-series data.
EN 50160	Perform measurement based on the EN 50160 standard.

*1: PQ3198 only. *2: This feature is known as "Trends only" for the PQ3100.

Automatic sensor detection to avoid erroneous measurement

Simply connect current sensors, touch "Sensor" on the screen, and the instrument will automatically detect sensor types and maximum current ranges.



Connect sensors ▶
Touch "Sensor" for automatic identification

Easy-to-understand display of parameters

Since you can switch the display to show all measurement parameters while measurement is underway, it's easy to check conditions. *Screenshot shows the PQ3100 display.

Waveforms Harmonics

RMS values Vectors

Simultaneously record event waveforms and trend graphs

Each time it makes a measurement, the PQ3198/PQ3100 records trend data for all parameters. When a power anomaly is detected, an event is recorded. Since the instrument records the maximum, minimum, and average values during the interval, you can rest assured that you won't miss peak values.

Extensive range of recording parameters


Example: Voltage dip



Simultaneous recording of waveforms and trend data


Event waveform

When an event occurs, the instrument records the instantaneous waveform for 0.2 seconds. Triggers can be set for all event parameters in parallel, and you can check recorded data on the display while measurement is in progress.

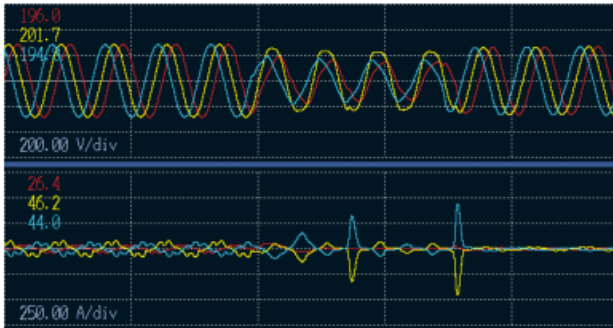

30 sec. event fluctuation trend data

When a voltage swell, dip, or inrush current event occurs, the PQ3198/PQ3100 can simultaneously record 1/2 RMS value fluctuations for 30 seconds.

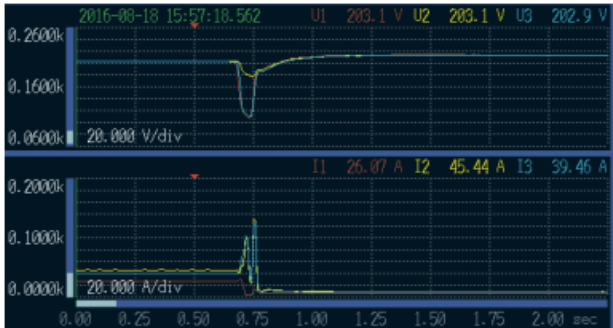

List of recording parameters

List of recording parameters

PQ3198 and PQ3100

- Transient voltage
- Voltage 1/2 RMS value
- Voltage waveform peak
- Voltage DC
- Voltage RMS value (phase)
- Voltage RMS value (line)
- Swell
- Dip
- Interruption
- Instantaneous flicker value
- Current waveform peak
- Current DC
- Current RMS value
- Inrush current
- Frequency 1 wave
- Frequency 200 ms
- Frequency 10 s
- Active power
- Active energy
- Reactive power
- Reactive energy
- Apparent power
- Power factor/displacement power factor
- Voltage reverse-phase unbalance factor
- Voltage zero-phase unbalance factor
- Current reverse-phase unbalance factor
- Current zero-phase unbalance factor
- Harmonic voltage
- Harmonic current
- Harmonic power
- Inter-harmonic voltage
- Inter-harmonic current
- Harmonic voltage phase angle
- Harmonic current phase angle
- Harmonic voltage-current phase difference
- Voltage total harmonic distortion
- Current total harmonic distortion
- K factor
- IEC flicker
- ΔV10 flicker

PQ3198 only

- Efficiency
- High-order harmonic components
- Voltage waveform comparison

PQ3100 only

- Voltage CF
- Rapid voltage change (RVC)
- Current 1/2 RMS value
- Current CF
- Electricity cost
- Apparent energy
- Apparent power demand amount
- Reactive power demand amount
- Apparent power demand value
- Reactive power demand value
- Apparent power demand value
- Power factor demand value

Flicker

The PQ3198/PQ3100 can simultaneously measure and record three channels of ΔV10 or IEC flicker.



Δ-Y, Y-Δ conversion function

When measuring a 3-phase/3-wire (3P3W3M) circuit or a 3-phase/4-wire circuit, the PQ3198/PQ3100 can switch between phase voltage and line voltage without changing the voltage connections.

Designed to accommodate every possible application so that it's easy to use in all field settings

Clamp sensors for every application

Flexible sensors: Easy installation in confined locations

Flexible current sensors provide a convenient way to measure double- and triple-wired power supplies and in confined locations, with capacities of up to 6000 A.



Auto-zero sensors: Stable measurement of DC power over extended periods of time

Auto-zero current sensors allow measurement of DC power over extended periods of time, eliminating the need to concern yourself with zero-point drift.



No need for an external power supply

Since sensor power is supplied by the instrument, there's no need for an AC adapter when using AC/DC sensors or flexible sensors.



Wide array of ranges to accommodate all applications

Use HIOKI sensors in an array of applications to measure equipment ranging from the secondary side of CTs to high-current wiring. The CT7136 offers three ranges* (5 A/50 A/500 A), as do HIOKI's flexible sensors (50 A/500 A/5000 A). Since the effective measurement range extends to 120% of the nominal range, flexible sensors can be used to measure currents of up to 6000 A.

*PQ3100 (PQ3198: 2 ranges [50 A/500 A]).



Delivering both safety and high accuracy

Exceptional safety

The PQ3100 supports CAT III (1000 V*) and CAT IV (600 V) situations, so it can safely measure service drops and distribution panels with a terminal-to-ground voltage of up to 1000 V.

*PQ3100 only (PQ3198: CAT IV [600 V]).



High accuracy

The PQ3198 complies with IEC 61000-4-30 Ed. 2 Class A, and the PQ3100 with IEC 61000-4-30 Class S, ensuring both instruments' ability to deliver highly reliable, high-precision measurement.

	PQ3198	PQ3100
Voltage RMS value accuracy	±0.1% of nominal voltage	±0.2% of nominal voltage
Swell/dip/interruption	±0.2% of nominal voltage	±0.3% of nominal voltage

Convenient tools

When it's hard to clip leads to terminals

In locations where it's hard to attach alligator clip-style leads to metal terminals, you can replace the tips of the voltage cords with magnetic adapters so that you can more easily detect the voltage.



Magnetic design (diameter: 11 mm)



Magnetic adapters
Red: 9804-01
Black: 9804-02

Magnetic adapters are easy to affix to terminals in confined locations.

Secure the PQA to the side of a distribution panel

Use two heavy-duty magnetic straps to attach the instrument to the side or door of a distribution panel.



Heavy-duty magnetic straps




Magnetic straps
Heavy-duty type: Z5020
Standard type: Z5004

Magnetic straps can also be used to help keep voltage cords from coming loose.

Extensive range of interfaces

Remote control via Ethernet

Use the PQ3198/PQ3100's HTTP server function to configure and monitor the instrument from a browser. You can also download data using the instrument's FTP server function.

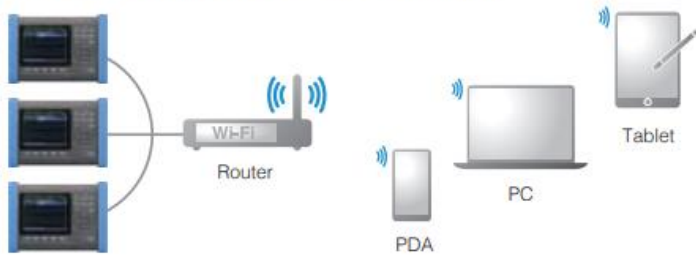


Email notification function*

The instrument can send emails when an event occurs or at a regular time every day. *PQ3100 only



Transfer data to a logger wirelessly*

Pair a data logger (that supports LR8410 Link) to the instrument via Bluetooth® wireless technology to transfer measured values for up to six parameters to the logger. In this way, you can use a single data logger to aggregate measurement data from multiple locations.

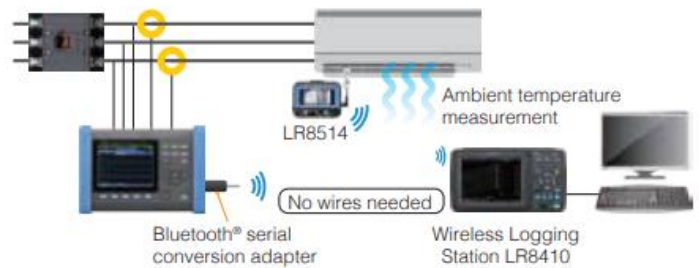

*PQ3100 only. Connection requires a serial-Bluetooth® wireless technology conversion adapter as recommended by HIOKI. Please contact your HIOKI distributor for more information.

Extended recording times supports permanent installation

Extended recording to an SD memory card

The PQ3198/PQ3100 can record time-series data and event waveforms to an SD memory card. Choose from 2 GB and 8 GB cards.

PQ3198 recording times (when using a 2 GB SD card)

Recording interval	All parameters	Power and harmonics	Power only	Event recording
1 sec.	16 hr.	23 hr.	11 days	Yes
3 sec.	2 days	3 days	34 days	Yes
15 sec.	10 days	14 days	24 weeks	Yes
30 sec.	21 days	29 days	49 weeks	Yes
1 min.	42 days	8 weeks	1 year	Yes
5 min.	30 weeks	42 weeks	1 year	Yes
10 min.	1 year	1 year	1 year	Yes
⋮	⋮	⋮	⋮	⋮

PQ3100 recording times (when using a 2 GB SD card)

Recording interval	Without harmonics	With harmonics	Event recording
200 ms	25 hours	No	No
1 sec.	5 days	7 hours	Yes
2 sec.	10 days	14 hours	Yes
10 sec.	53 days	2 days	Yes
1 min.	321 days	17 days	Yes
10 min.	1 year	178 days	Yes
30 min.	1 year	1 year	Yes
⋮	⋮	⋮	⋮



2 GB



8 GB

Analyze data and generate reports with HIOKI's PQ ONE power quality analysis software


Standard accessory

Download the latest version from HIOKI's website for free. Sample data from actual instruments is also available for download.

Loading measurement data

Review multiple data sets at a glance

Group data from different measurement locations, times, and dates into folders and view them together.

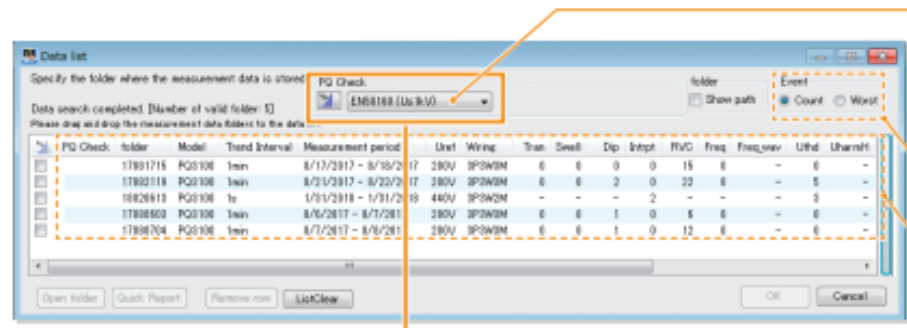


PQ Check function

Automatically check data to see if it complies with power quality standards. (Thresholds can be customized.)

Toggle the display between event counts and worst values.

Display event status and other information in the list of loaded data.

Example: Using PQ Check to assess whether a given set of data complies with the EN 50160 standard

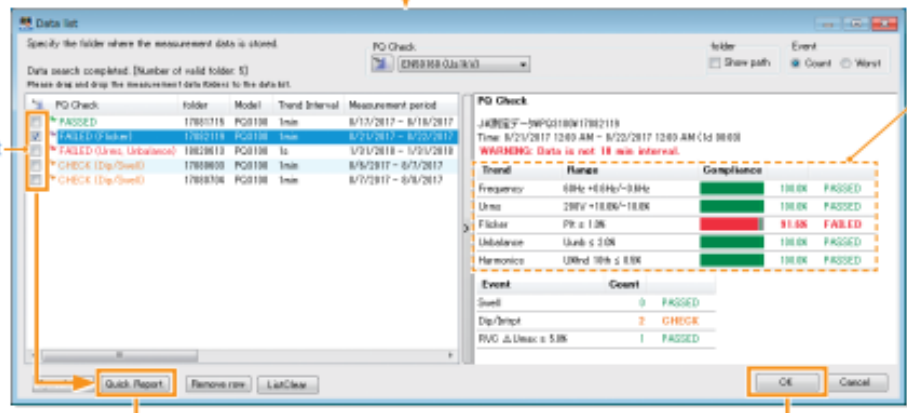

PASS/FAIL judgments for the standard

Understand at a glance that the flicker value falls outside the standard.

Output FAIL (non-compliant) data with a single click using the Quick Report function.

Choose report parameters.

Generate a quick report

View a detailed analysis on the main screen

Simple report creation **Quick Report function**

Detailed analysis **Display a list of analytical data**

Group together trend graphs for multiple data sets and output them as a report. This feature is useful when you wish to compare dates from a repeat recording run or data from multiple locations.

Display detailed measurement data, including event statistics, an event list, and event graphs. Simply choose the parameters you need to output to the report.



See pages 13 to 15 for more information.

**1** Select data to load

Load a new data set or choose the most recently used data set.

2 Option settings

Configure options such as display parameters, language, and cache files.

3 Verify settings at the time of measurement

Display the status screen with information such as the instrument settings that were in effect at the time of measurement.

4 Report creation

Generate detailed reports with trend and event information.

5 CSV file conversion

Output trends and event waveforms as a CSV-format file.

6 Statistical values and standard values

Display statistical values and perform evaluations and analysis based on standards.

7 User manual and version information

Review the PQ ONE user manual and software version.

8 Measured value trend graph

Zoom in and out or use the cursor to display measured values.

9 Trend graph display interval

Set the interval for which to display trend data on the screen.

10 Event statistics and ITIC curve

Display bar graphs with data such as the number of events that occurred.

11 Event list

Display information including the event type, time, duration, and channel.

12 Detailed event data


Display detailed information about the event selected in the event list.

Analyze data and generate reports with PQ ONE power quality analysis software

Examples of the types of analyses that can be performed with PQ ONE

Event statistics

Display statistics about events by date or time. This feature makes it easy to discover anomalies that occur at particular times of day or on particular days of the week. In addition, you can perform ITIC (CBEMA) curve analyses (using tolerance curves), which are used by power quality management standards in the U.S.

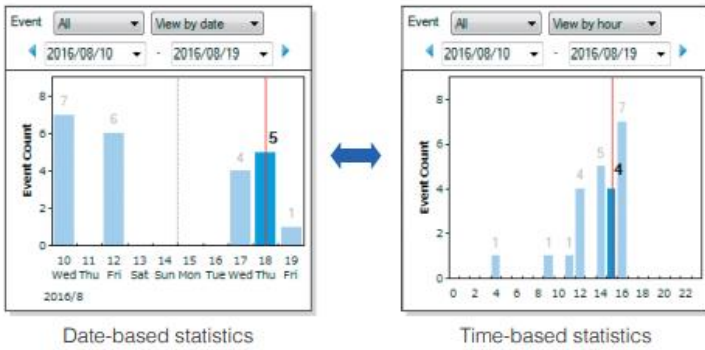

Event list


Display statistics about events by date or time of day. This feature makes it easy to discover power supply anomalies that occur at particular times of day or on particular days of the week.

No.	Time	Event	I/O	CH
116	11:18:40.225	Uthd	IN	CH3
119	11:18:40.825	Uthd	OUT	CH3
127	15:57:19.238	Dip	IN	CH3
128	15:57:19.318	Dip	OUT	CH1
128	15:57:19.268	Uthd	IN	CH1
128	15:57:19.268	Uthd	IN	CH2
128	15:57:19.268	Uthd	IN	CH3
129	15:57:19.469	Uthd	OUT	CH1

Click the event statistics bar graph to display the event list.

ITIC curve


Perform ITIC (CBEMA) curve analyses (using tolerance curves), which are used by power quality management standards in the U.S. This feature lets you display the event duration and worst values for voltage swells, voltage dips, and interruptions.

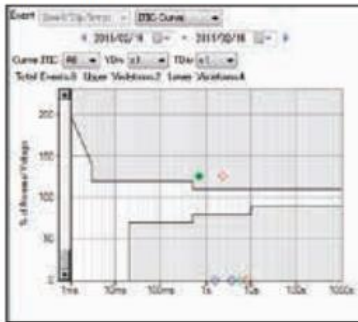

Example ITIC curve screen

Trend graphs

Display voltage, current, frequency, harmonics, unbalance factor, power, energy, and other data as a time series. Set the display range as desired on the screen and output reports with the shown data. PQ ONE can generate a demand display for the PQ3198, even though that model does not include demand measurement.

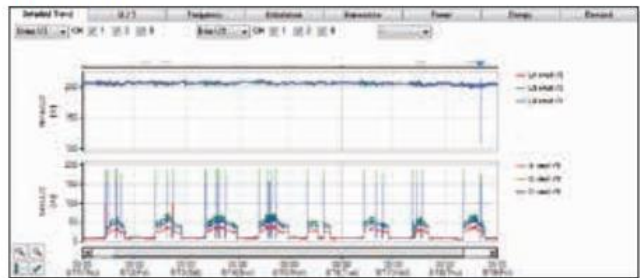


Choose the measurement parameter, channel, or max./min./avg. value.

Event details


Analyze 200 ms event waveforms, including waveforms, harmonics, vector, and numerical displays. You can also display 30 sec. event fluctuation data, transient waveforms, high-order harmonic waveforms¹, high-order harmonic frequency analysis data¹, and 11 sec. waveforms preceding events².

¹: PQ3198 only. ²: PQ3100 only.

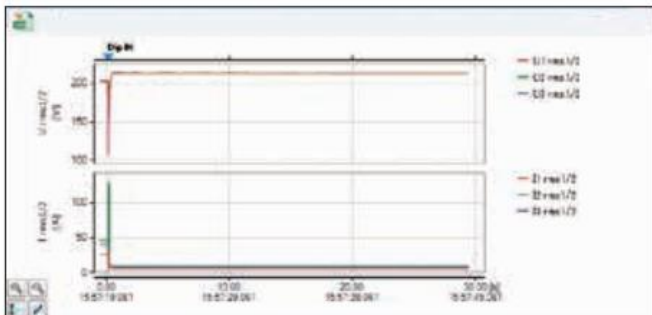


Peak level display

Display a bar graph showing peak values during the voltage harmonic or current harmonic trend display interval. You can check average peak and maximum peak measured values for the period of time selected with the cursor to the right of the graph.

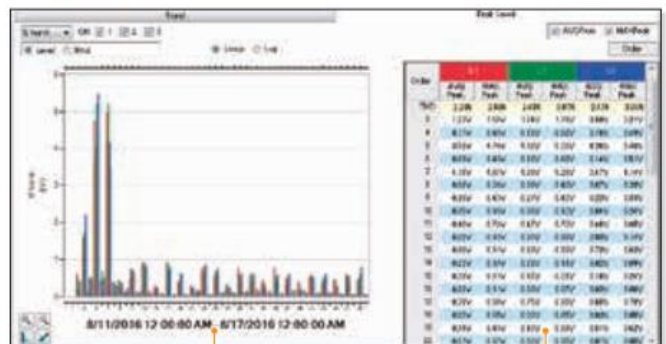

High-order harmonics and frequency analysis display*


Display high-order harmonic event waveforms (2 to 80 kHz) and associated frequency analysis data. By displaying the frequency analysis, you can determine the frequency band in which noise is occurring. *PQ3198 only.

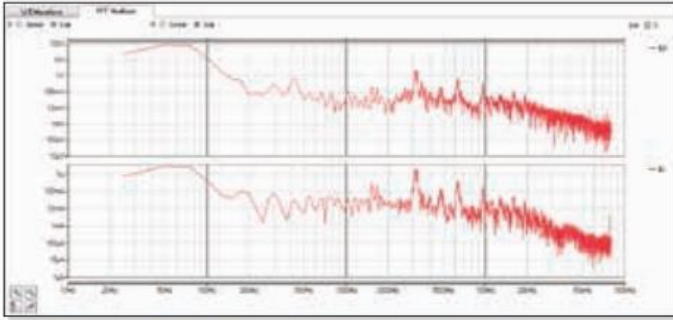

Example high-order harmonics and frequency analysis screen

Statistics display function


Present statistical data for voltage, current, frequency, harmonics, flicker and other parameters on the Statistics screen. You can also see the maximum and minimum (with time of occurrence), average, 5%, 50%, or 95% of the value (default values, user settable) of any selected parameter.

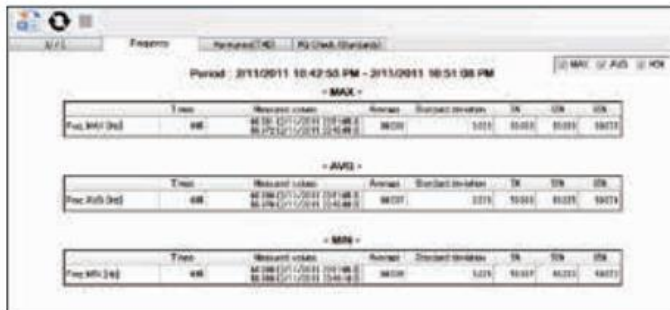

Example frequency screen

EN 50160 judgment function

Evaluate whether data complies with the EN 50160 standard by analyzing it and generating a judgment based on voltage fluctuations during the trend interval. You can also customize the judgment criteria and parameters.

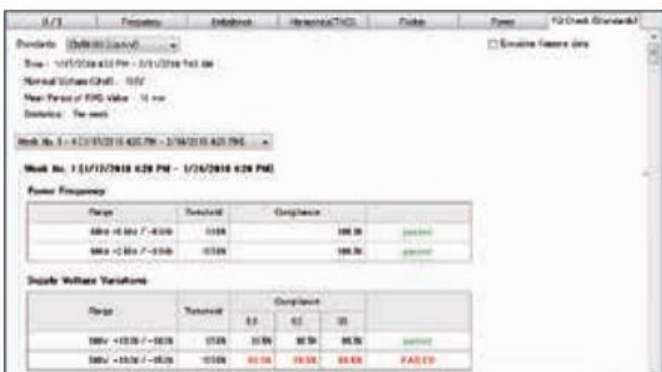

Display detailed settings and judgment results


Report creation

Automatically generate reports in Microsoft Word* by simply selecting the necessary data categories. Add comments as required.

*Microsoft Word is a product of Microsoft Corporation.



Choose report parameters

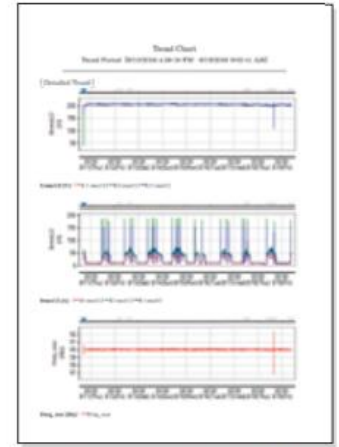

Output a report with only the necessary data

CSV conversion and PQDIF output function

Output CSV and PQDIF format files for the parameters you choose. PQDIF format files can also be uploaded to the software.



PQDIF output settings screen

Compute TDD (Total Demand Distortion) based on the IEEE519 standard

Calculate TDD using PQ ONE.

$$TDD_I = \sqrt{I_2^2 + I_3^2 + \dots + I_{49}^2 + I_{50}^2} / I_L$$

I_L : Maximum current demand (configure in PQ ONE)

Display language


Choose from English, German, French, Italian, Spanish, Turkish, Japanese, Simplified Chinese, Traditional Chinese, and Korean.



Choose "Automatic" to use the Windows language.



PC Application Program GENNECT One

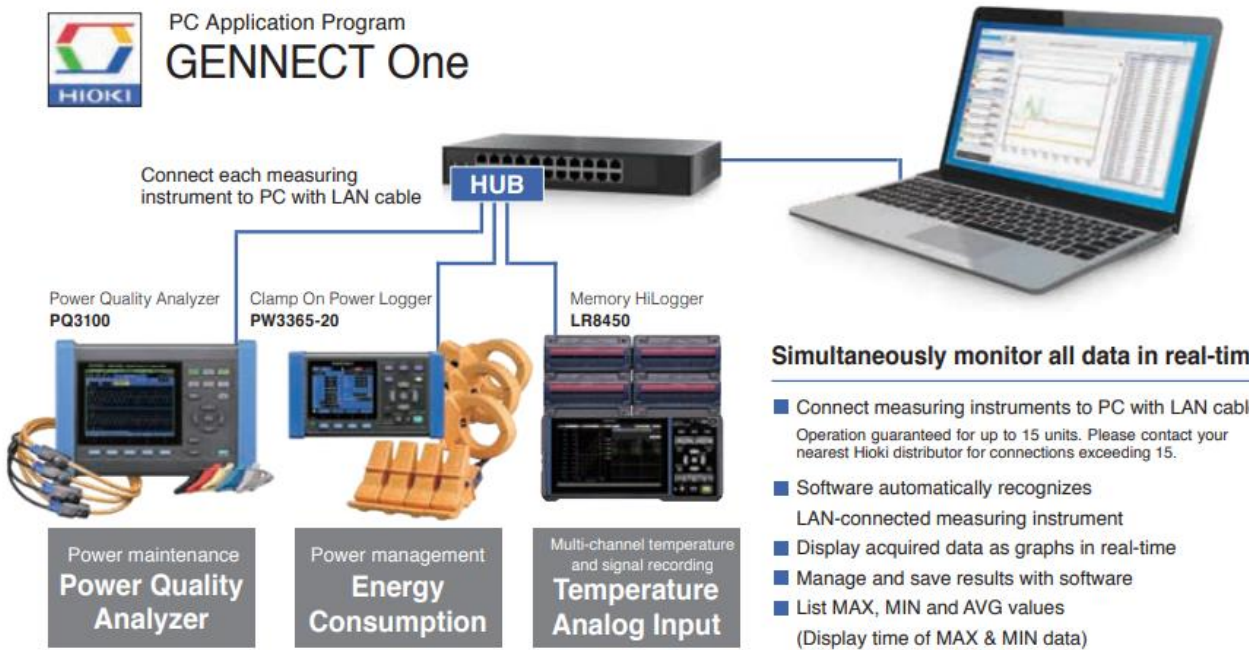

Compatible instruments	Available items to monitor and save on PC		Number of items able to be saved	Recording time
POWER QUALITY ANALYZER PQ3100, PQ3198	Voltage Current Power	Instantaneous value of each interval; MAX, MIN, AVG value of each interval	Save up to 512 items *Maximum 32 items when simultaneously displaying graphs	When memory size of acquired data reaches to 64MB, data will be separated automatically [Continuous measurement] When storage capacity falls below 512MB, measurement will stop
CLAMP ON POWER LOGGER PW3365				
CLAMP ON POWER LOGGER PW3366				
MEMORY HILOGGER LR8450, LR8450-01	Temperature Analog Input	Instantaneous value of each interval		
WIRELESS LOGGING STATION LR8410				

Get results from the job site in real-time

Present data from multiple sources as a graph or list together in real-time

Entire screen



1. Monitor display (Max 512 items)

Display each measured data in real-time

2. Graph display (Max 32 items)

Display selected data as graphs


3. List display (Max 32 items)

Display selected data in list

1. Monitor



2. Graph

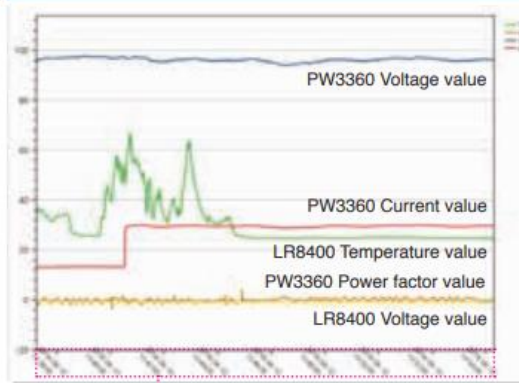

3. List

logging time (display up to 1024 points)

Other functionality

LAN remote control function

The application displays a virtual instrument and allows you to control it directly with the mouse. You can also easily change instrument settings and control the instrument, for example to start and stop measurement.



LAN automatic file download function

This function lets you acquire data in real time on a PC, including data created when the instrument's trigger is activated and measurement files that are automatically generated on a daily basis. Example uses include capturing abnormal phenomena with an instrument installed in the field and automatically acquiring daily power consumption data on a PC.


Automatically transfer measurement files to a PC.



Download GENNECT One

Interfaces


PQ3198 top

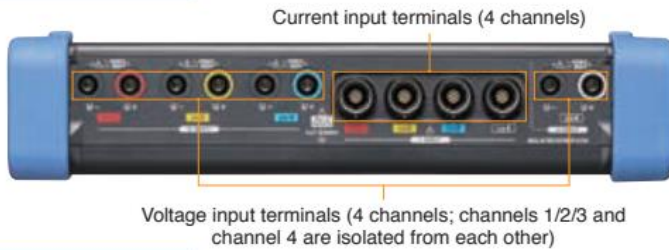

PQ3100 top



Shared features: Side

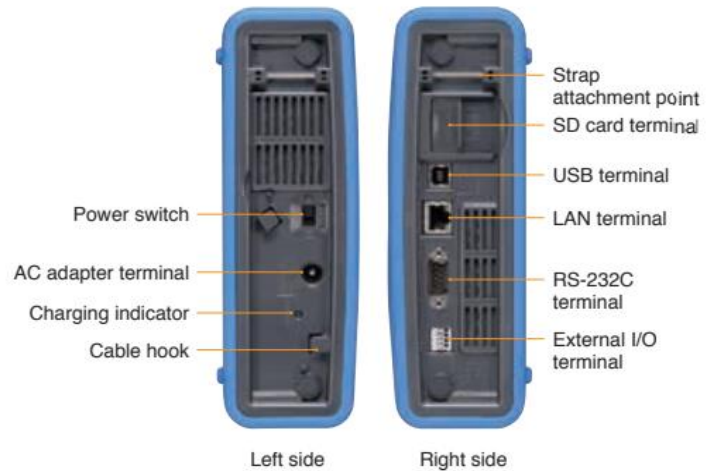

Simple comparison chart

PQ3198 features

The PQ3198 offers an extensive range of event parameters. This model is ideal for use in troubleshooting-related measurement since it can capture a variety of power supply anomalies. Additionally, it can measure power and efficiency across two circuits carrying different voltages (3-phase and DC, etc.).

PQ3100 features

The PQ3100 offers the QUICK SET function, which makes it easy to generate reliable measurements. Additionally, it can record 11 sec. event waveforms, yielding extended waveforms when anomalies occur. It can also be used in applications such as load rejection testing of solar power systems.

Model		PQ3198	PQ3100
IEC 61000-4-30 standard compliance		Class A	Class S
Fundamental frequency		DC/50 Hz/60 Hz/400 Hz	DC/50 Hz/60 Hz
Measurement lines		1-phase/2-wire, 1-phase/3-wire, 3-phase/3-wire, or 3-phase/4-wire + CH 4	
Event parameters	Events that can be measured to capture anomalies	RMS values Voltage/current waveform peak Voltage waveform comparison Harmonics Unbalance factor Power	Rapid voltage change (RVC)
	Transient voltage	2 MS/s 6 kV	200 kS/s 2.2 kV
Measurement parameters	Efficiency	CH 4 power calculation Efficiency calculation	N/A
	High-order harmonics	2 kHz to 80 kHz	N/A
	Power	Power 2-circuit measurement	N/A
	Voltage	Active power, reactive power, apparent power, power factor, displacement power factor, active energy, reactive energy	
	Current	1/2 RMS value (half-wave shifted 1-wave calculation), RMS value, waveform peak, DC value, unbalance factor (reverse-phase/zero-phase), frequency (1-wave/200 ms/10 sec.)	
	Harmonics	Inrush current (half-wave), RMS value, waveform peak, DC value, unbalance factor (reverse-phase/zero-phase), K factor	
	Flicker	0th order (DC) to 50th order, voltage/current/power, phase angle (voltage/current), voltage-current phase difference, total harmonic distortion (voltage/current)	
Event measurement	Inter-harmonics	Pst, Plt, ΔV10 (3-channel simultaneous measurement)	
	Maximum number of recordable events	0.5th order to 49.5th order, voltage/current	
	Waveform acquired at time of event	9999 events × 366 day repeat	
	Waveform acquired before event	2 waveforms	Max. 1 sec.
	Waveform acquired after event	Max. 1 sec. (for 5 successive events)	Max. 10 sec.
Voltage measurement	Event statistics processing	N/A	Display of count for each event type and each day
	CH 1/2/3 and CH 4 isolation	Yes	N/A
	Measurement accuracy	High accuracy: ±0.1% rdg.	±0.2% rdg.
Current measurement	Maximum rated terminal-to-ground voltage	600 V (CAT IV)	1000 V (CAT III) 600 V (CAT IV)
	Measurement of 4 single-phase circuits	Yes	Yes
Time-series measurement	Sensor power supply	Yes	Yes
	1 year recording	Yes	Yes
Setup assistance	Recording interval times	1 sec. to 2 hours	200 ms/600 ms/1 sec. to 2 hours
	Setup assistance	Simplified setup function	QUICK SET (navigation-style assistance from connecting the instrument to the start of recording)
Battery operation		3 hours	8 hours

Specifications

The following specifications apply when the PQ3198/PQ3100 is set to a measurement frequency of 50/60 Hz. For more detailed specifications, including for when the PQ3198 is set to 400 Hz, please download the user manual from the HIOKI website.

Basic specifications	PQ3198	PQ3100
Number of channels	Voltage: 4 / Current: 4	
Input terminal type	Voltage: Plug-in terminals (safety terminals) / Current: Dedicated connectors (HIOKI PL 14)	
Connections	Any of the following + additional input to CH 4: 1-phase/2-wire 1-phase/3-wire 1-phase/3-wire/1 voltmeter *PQ3100 only	3-phase/3-wire/2 power meter 3-phase/3-wire/3 power meter 3-phase/4-wire/2.5 element 3-phase/4-wire
Input resistance	Voltage inputs: 4 MΩ / Current inputs: 100 kΩ	Voltage inputs: 5 MΩ / Current inputs: 200 kΩ
Maximum input voltage	Voltage inputs: 1000 V AC, ±600 V DC, 6000 V _{peak}	
Maximum rated terminal-to-ground voltage	600 V AC (CAT IV) with an expected transient overvoltage of 8000 V	1000 V AC (CAT III) or 600 V AC (CAT IV) with an expected transient overvoltage of 8000 V
Sampling frequency	Parameters other than transient voltage: 200 kHz; transient voltage: 2 MHz	200 kHz for all parameters
A/D converter resolution	Parameters other than transient voltage: 16 bits; transient voltage: 12 bits	16 bits
Display range	Voltage: 0.48 V to 780 V / Current: 0.5% to 130% of range Power: 0.0% to 130% of range Parameters other than above: 0% to 130% of range	Voltage: 2 V to 1300 V / Current: 0.4% to 130% of range
Effective measurement ranges	Voltage: 10 V to 780 V AC, peak of ±2200 V / 1 V to 600 V DC Current: 1% to 120% of range, peak of ±400% of range Power: 0.15% to 130% of range (When voltage and current both fall within the effective measurement range)	Voltage: 10 V to 1000 V AC, peak of ±2200 V / 5 V to 1000 V DC Current: 5% to 120% of range, peak of ±400% of range Power: 5% to 120% of range (When voltage and current both fall within the effective measurement range)

Accuracy specifications

Accuracy guarantee conditions	Accuracy guarantee duration: 1 year / Post-adjustment accuracy guarantee duration: 1 year / Accuracy guarantee temperature and humidity range: 23°C ±5°C, 80% RH or less / Warm-up time: 30 min. or greater	
Temperature coefficient	0.03% f.s./°C (DC measurement, add ±0.05% f.s./°C)	0.1% f.s./°C
Common-mode voltage effects	Within 0.2% f.s. (600 Vrms AC, 50 Hz/60 Hz, between voltage input and enclosure)	Within 0.2% f.s. (1000 Vrms AC, 50 Hz/60 Hz, between voltage input and enclosure)
External magnetic field effects	Voltage: Within ±3 V Current: Within 1.5% f.s. (400 Arms/m AC, in 50 Hz/60 Hz magnetic field)	Within 1.5% f.s. (400 Arms/m AC, in 50 Hz/60 Hz magnetic field)

Measurement parameters

Measurement parameters	Transient voltage	Current waveform peak	Reactive energy	Inter-harmonic voltage
	Voltage 1/2 RMS value	Current DC	Apparent power	Inter-harmonic current
	Voltage waveform peak	Current RMS value	Power factor/displacement power factor	Harmonic voltage phase angle
	Voltage DC	Inrush current	Voltage reverse-phase unbalance factor	Harmonic current phase angle
	Voltage RMS value (phase)	Frequency 1 wave	Voltage zero-phase unbalance factor	Harmonic voltage-current phase difference
	Voltage RMS value (line)	Frequency 200 ms	Current reverse-phase unbalance factor	Voltage total harmonic distortion
	Swell	Frequency 10 sec.	Current zero-phase unbalance factor	Current total harmonic distortion
	Dip	Active power	Harmonic voltage	K factor
	Interruption	Active energy	Harmonic current	IEC flicker
	Instantaneous flicker value	Reactive power	Harmonic power	ΔV10 flicker
	Efficiency		Voltage CF	Reactive power demand amount*
	High-order harmonic components		Rapid voltage change (RVC)	Apparent power demand amount*
	Voltage waveform comparison		Current 1/2 RMS value	Active power demand value
			Current CF	Reactive power demand value
			Electricity cost	Apparent power demand value
			Apparent energy	Power factor demand value
			Active power demand amount*	*Data output to SD memory card only

Measurement specifications

Transient voltage (Tran)	Detected based on waveform after the fundamental wave component has been eliminated from the sampled waveform.	
	Measurement range: ±6.000 kV _{peak} Measurement band: 5 kHz (-3 dB) to 700 kHz (-3 dB) Measurement accuracy: ±5.0% rdg. ±1.0% f.s.	Measurement range: ±2.200 kV _{peak} Measurement band: 5 kHz (-3 dB) to 40 kHz (-3 dB) Measurement accuracy: ±5.0% rdg. ±1.0% f.s.
Voltage 1/2 RMS value (Urms1/2), current 1/2 RMS value (Irms1/2)	Voltage 1/2 RMS value: Calculated as the RMS value for 1 sampled waveform that has been overlapped every half-wave. Current 1/2 RMS value: Calculated as the RMS value every half-wave. Measurement accuracy Voltage: ±0.2% of the nominal voltage (for input of 10 V to 660 V) ±0.2% rdg. ±0.08% f.s. (for input other than above) Current: ±0.3% rdg. ±0.5% f.s. + current sensor accuracy	Calculated as the RMS value for 1 sampled waveform that has been overlapped every half-wave. Measurement accuracy Voltage: ±0.3% of the nominal voltage (for input of 10 V to 660 V) ±0.2% rdg. ±0.1% f.s. (for input other than above) Current: ±0.2% rdg. ±0.1% f.s. + current sensor accuracy
Swell (Swell), dip (Dip), interruption (Intrpt)	Detected when the voltage 1/2 RMS value exceeds the threshold. Measurement accuracy: Same as voltage 1/2 RMS value Fluctuation data: Voltage and current 1/2 RMS value data is saved.	
Rapid voltage change (RVC)	None	Detected when the 1-sec. average of voltage 1/2 RMS values exceeds the threshold; however, if the average is less than the dip threshold or greater than the swell threshold, the event is detected as a dip (or swell), rather than as an RVC. Measurement accuracy: Same as voltage 1/2 RMS value ΔU _{ss} : Absolute difference between the 1-sec. average of voltage 1/2 RMS values immediately before the event and the first 1-sec. average of voltage 1/2 RMS values after the event [V] ΔU _{max} : Absolute maximum difference between all voltage 1/2 RMS values during the event and the 1-sec. average of voltage 1/2 RMS values immediately before the event [V] Fluctuation data: Voltage and current 1/2 RMS value data is saved.
Inrush current (Inrush)	Same as current 1/2 RMS value. Inrush current is detected when the setting is exceeded in the positive direction. Measurement accuracy: Same as current 1/2 RMS value Fluctuation data: Current 1/2 RMS Value data	Calculated as the current RMS value for data obtained by sampling the current waveform every half-wave. Inrush current is detected when the setting is exceeded in the positive direction. Measurement accuracy: ±0.3% rdg. ±0.3% f.s. + current sensor accuracy Fluctuation data: Voltage 1/2 RMS value data and inrush current RMS value data are saved.

Voltage RMS value (Urms), current RMS value (Irms)	Measured using a 200 ms aggregate. Measurement accuracy Voltage: $\pm 0.1\%$ of the nominal voltage (for input of 10 V to 660 V) $\pm 0.2\%$ rdg. $\pm 0.08\%$ f.s. (input other than above) Current: $\pm 0.1\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy	Measured using a 200 ms aggregate. Measurement accuracy Voltage: $\pm 0.2\%$ of the nominal voltage (for input of 10 V to 660 V) $\pm 0.1\%$ rdg. $\pm 0.1\%$ f.s. (for input other than above) Current: $\pm 0.1\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy																																										
Voltage DC value (Udc), current DC value (Idc)	Average of 200 ms aggregate values (calculated using CH 4 only) Measurement accuracy Voltage: $\pm 0.3\%$ rdg. $\pm 0.08\%$ f.s. Current: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy	Average of 200 ms aggregate values Measurement accuracy Voltage: $\pm 0.3\%$ rdg. $\pm 0.1\%$ f.s. Current: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy																																										
Measurement specifications	<table border="1"> <thead> <tr> <th></th> <th>PQ3198</th> <th>PQ3100</th> </tr> </thead> <tbody> <tr> <td>Voltage waveform peak (Upk), current waveform peak (Ipk)</td> <td>Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 1200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)</td> <td>Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 2200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)</td> </tr> <tr> <td>Voltage waveform comparison</td> <td>Measurement method: A judgment area is automatically generated based on the previous 200 ms aggregate waveform and compared with the judgment waveform to trigger events. Waveform judgment is performed for one 200 ms aggregate at a time. Comparison window width: 10 waves (for 50 Hz input) or 12 waves (for 60 Hz input) Number of window points: 4096 points synchronized with harmonic calculations</td> <td>None</td> </tr> <tr> <td>Voltage CF value (Ucf), current CF value (Icf)</td> <td>None</td> <td>Calculated from the voltage RMS value and voltage waveform peak value.</td> </tr> <tr> <td>Frequency 1 wave (Freq_wav)</td> <td colspan="2">Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the duration of a single wave on voltage CH 1. Measurement accuracy: ± 0.200 Hz or less</td> </tr> <tr> <td>Frequency 200 ms (Freq)</td> <td colspan="2">Calculated as the reciprocal of the cumulative time of the whole cycles that occur during 200 ms on voltage CH 1. Measurement accuracy: ± 0.020 Hz or less</td> </tr> <tr> <td>Frequency 10 sec. (Freq10s)</td> <td colspan="2">Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the specified 10 sec. interval on voltage CH 1. Measurement accuracy: ± 0.003 Hz or less (45 Hz or more) ± 0.010 Hz or less (less than 45 Hz)</td> </tr> <tr> <td>Active power (P), apparent power (S), reactive power (Q)</td> <td> <p>Active power Measured every 200 ms.</p> <p>Apparent power Calculated from the voltage RMS value and the current RMS value.</p> <p>Reactive power Calculated from the apparent power S and the active power P.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy (CH 4 only) AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values</p> </td> <td> <p>Active power Measured every 200 ms.</p> <p>Apparent power RMS value calculation: Calculated from the voltage RMS value and the current RMS value. Fundamental wave calculation: Calculated from the fundamental wave active power and the fundamental wave reactive power.</p> <p>Reactive power RMS value calculation: Calculated from the apparent power S and the active power P. Fundamental wave calculation: Calculated from the fundamental wave voltage and current.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values During fundamental wave calculation: For fundamental frequencies of 45 Hz to 66 Hz $\pm 0.3\%$ rdg. $\pm 0.1\%$ f.s. + current sensor specifications (reactive factor = 1) Reactive factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> </td> </tr> <tr> <td>Efficiency (Eff)</td> <td>Measurement method Calculated as the ratio of the active power values for the channel pair. Measurement accuracy: ± 0.1 dgt. relative to calculation from measured values</td> <td>None</td> </tr> <tr> <td>Active energy (WP+, WP-), reactive energy (WQ_LAG, WQ_LEAD), apparent energy (WS)</td> <td>Energy is measured from the start of recording. Active energy: Calculated separately from the active power for consumption and regeneration. Reactive energy: Integrated separately from the reactive power for lag and lead. Apparent energy: Integrated from the apparent power. *PQ3100 only</td> <td>Measurement accuracy Active energy: Active power measurement accuracy ± 10 dgt. Reactive energy: Reactive power measurement accuracy ± 10 dgt. Apparent energy: Apparent power measurement accuracy ± 10 dgt. *PQ3100 only Cumulative time accuracy: ± 10 ppm</td> </tr> <tr> <td>Energy cost (Ecost)</td> <td>None</td> <td>Calculated by multiplying active energy (consumption) (WP+) by the electricity unit cost (/kWh). Measurement accuracy: ± 1 dgt. relative to calculation from measured values</td> </tr> <tr> <td>Power factor (PF), displacement power factor (DPF)</td> <td colspan="2">Displacement power factor (DPF): Calculated from the fundamental wave active power and reactive power. Power factor: Calculated from the apparent power S and the active power P. Displacement power factor measurement accuracy For input with a voltage of 100 V or greater and current of 10% of the range or greater When displacement power factor = 1: $\pm 0.05\%$ rdg.; when $0.8 \leq$ displacement power factor < 1: $\pm 1.50\%$ rdg.; when $0 <$ displacement power factor < 0.8: $\pm(1 - \cos(\varphi + 0.2865)/\cos(\varphi)) \times 100\%$ rdg. + 50 dgt. (reference value), where φ represents the 1st-order display value for the harmonic voltage-current phase difference Add the current sensor phase accuracy to each.</td> </tr> <tr> <td>Demand amount</td> <td>PQ3198 Can be calculated using PQ ONE.</td> <td>PQ3100 Energy is measured during each interval. (Values are recorded but not displayed.) Measurement accuracy Active power demand amount (Dem_WP+, Dem_WP-): Active power measurement accuracy ± 10 dgt. Reactive power demand amount (Dem_WQ_LAG, Dem_WQ_LEAD): Reactive power measurement accuracy ± 10 dgt. Apparent power demand amount (Dem_WS): Apparent power measurement accuracy ± 10 dgt. Cumulative time accuracy: ± 10 ppm ± 1 sec. (23°C)</td> </tr> <tr> <td>Demand value</td> <td>Can be calculated using PQ ONE.</td> <td>Active power demand value (Dem_P+, Dem_P-), reactive power demand value (Dem_Q_LAG, Dem_Q_LEAD), apparent power demand value (Dem_S) Average power values are measured during each interval. Measurement accuracy: ± 1 dgt. relative to calculation from measured values</td> </tr> </tbody> </table>			PQ3198	PQ3100	Voltage waveform peak (Upk), current waveform peak (Ipk)	Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 1200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)	Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 2200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)	Voltage waveform comparison	Measurement method: A judgment area is automatically generated based on the previous 200 ms aggregate waveform and compared with the judgment waveform to trigger events. Waveform judgment is performed for one 200 ms aggregate at a time. Comparison window width: 10 waves (for 50 Hz input) or 12 waves (for 60 Hz input) Number of window points: 4096 points synchronized with harmonic calculations	None	Voltage CF value (Ucf), current CF value (Icf)	None	Calculated from the voltage RMS value and voltage waveform peak value.	Frequency 1 wave (Freq_wav)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the duration of a single wave on voltage CH 1. Measurement accuracy: ± 0.200 Hz or less		Frequency 200 ms (Freq)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during 200 ms on voltage CH 1. Measurement accuracy: ± 0.020 Hz or less		Frequency 10 sec. (Freq10s)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the specified 10 sec. interval on voltage CH 1. Measurement accuracy: ± 0.003 Hz or less (45 Hz or more) ± 0.010 Hz or less (less than 45 Hz)		Active power (P), apparent power (S), reactive power (Q)	<p>Active power Measured every 200 ms.</p> <p>Apparent power Calculated from the voltage RMS value and the current RMS value.</p> <p>Reactive power Calculated from the apparent power S and the active power P.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy (CH 4 only) AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values</p>	<p>Active power Measured every 200 ms.</p> <p>Apparent power RMS value calculation: Calculated from the voltage RMS value and the current RMS value. Fundamental wave calculation: Calculated from the fundamental wave active power and the fundamental wave reactive power.</p> <p>Reactive power RMS value calculation: Calculated from the apparent power S and the active power P. Fundamental wave calculation: Calculated from the fundamental wave voltage and current.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values During fundamental wave calculation: For fundamental frequencies of 45 Hz to 66 Hz $\pm 0.3\%$ rdg. $\pm 0.1\%$ f.s. + current sensor specifications (reactive factor = 1) Reactive factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p>	Efficiency (Eff)	Measurement method Calculated as the ratio of the active power values for the channel pair. Measurement accuracy: ± 0.1 dgt. relative to calculation from measured values	None	Active energy (WP+, WP-), reactive energy (WQ_LAG, WQ_LEAD), apparent energy (WS)	Energy is measured from the start of recording. Active energy: Calculated separately from the active power for consumption and regeneration. Reactive energy: Integrated separately from the reactive power for lag and lead. Apparent energy: Integrated from the apparent power. *PQ3100 only	Measurement accuracy Active energy: Active power measurement accuracy ± 10 dgt. Reactive energy: Reactive power measurement accuracy ± 10 dgt. Apparent energy: Apparent power measurement accuracy ± 10 dgt. *PQ3100 only Cumulative time accuracy: ± 10 ppm	Energy cost (Ecost)	None	Calculated by multiplying active energy (consumption) (WP+) by the electricity unit cost (/kWh). Measurement accuracy: ± 1 dgt. relative to calculation from measured values	Power factor (PF), displacement power factor (DPF)	Displacement power factor (DPF): Calculated from the fundamental wave active power and reactive power. Power factor: Calculated from the apparent power S and the active power P. Displacement power factor measurement accuracy For input with a voltage of 100 V or greater and current of 10% of the range or greater When displacement power factor = 1: $\pm 0.05\%$ rdg.; when $0.8 \leq$ displacement power factor < 1: $\pm 1.50\%$ rdg.; when $0 <$ displacement power factor < 0.8: $\pm(1 - \cos(\varphi + 0.2865)/\cos(\varphi)) \times 100\%$ rdg. + 50 dgt. (reference value), where φ represents the 1st-order display value for the harmonic voltage-current phase difference Add the current sensor phase accuracy to each.		Demand amount	PQ3198 Can be calculated using PQ ONE.	PQ3100 Energy is measured during each interval. (Values are recorded but not displayed.) Measurement accuracy Active power demand amount (Dem_WP+, Dem_WP-): Active power measurement accuracy ± 10 dgt. Reactive power demand amount (Dem_WQ_LAG, Dem_WQ_LEAD): Reactive power measurement accuracy ± 10 dgt. Apparent power demand amount (Dem_WS): Apparent power measurement accuracy ± 10 dgt. Cumulative time accuracy: ± 10 ppm ± 1 sec. (23°C)	Demand value	Can be calculated using PQ ONE.	Active power demand value (Dem_P+, Dem_P-), reactive power demand value (Dem_Q_LAG, Dem_Q_LEAD), apparent power demand value (Dem_S) Average power values are measured during each interval. Measurement accuracy: ± 1 dgt. relative to calculation from measured values
	PQ3198	PQ3100																																										
Voltage waveform peak (Upk), current waveform peak (Ipk)	Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 1200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)	Maximum and minimum points in sampled data within 200 ms aggregate Measurement range Voltage: ± 2200.0 Vpk Current: 400% current range Measurement accuracy Voltage: 5% of the nominal voltage (for input of 10% to 150% of the nominal voltage) 2% f.s. (for input other than above) Current: 5% rdg. (for input of at least 50% f.s.) 2% f.s. (for input other than above)																																										
Voltage waveform comparison	Measurement method: A judgment area is automatically generated based on the previous 200 ms aggregate waveform and compared with the judgment waveform to trigger events. Waveform judgment is performed for one 200 ms aggregate at a time. Comparison window width: 10 waves (for 50 Hz input) or 12 waves (for 60 Hz input) Number of window points: 4096 points synchronized with harmonic calculations	None																																										
Voltage CF value (Ucf), current CF value (Icf)	None	Calculated from the voltage RMS value and voltage waveform peak value.																																										
Frequency 1 wave (Freq_wav)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the duration of a single wave on voltage CH 1. Measurement accuracy: ± 0.200 Hz or less																																											
Frequency 200 ms (Freq)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during 200 ms on voltage CH 1. Measurement accuracy: ± 0.020 Hz or less																																											
Frequency 10 sec. (Freq10s)	Calculated as the reciprocal of the cumulative time of the whole cycles that occur during the specified 10 sec. interval on voltage CH 1. Measurement accuracy: ± 0.003 Hz or less (45 Hz or more) ± 0.010 Hz or less (less than 45 Hz)																																											
Active power (P), apparent power (S), reactive power (Q)	<p>Active power Measured every 200 ms.</p> <p>Apparent power Calculated from the voltage RMS value and the current RMS value.</p> <p>Reactive power Calculated from the apparent power S and the active power P.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy (CH 4 only) AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values</p>	<p>Active power Measured every 200 ms.</p> <p>Apparent power RMS value calculation: Calculated from the voltage RMS value and the current RMS value. Fundamental wave calculation: Calculated from the fundamental wave active power and the fundamental wave reactive power.</p> <p>Reactive power RMS value calculation: Calculated from the apparent power S and the active power P. Fundamental wave calculation: Calculated from the fundamental wave voltage and current.</p> <p>Measurement accuracy</p> <p>Active power DC: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy AC: $\pm 0.2\%$ rdg. $\pm 0.1\%$ f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p> <p>Apparent power ± 1 dgt. relative to calculation from measured values</p> <p>Reactive power During RMS value calculation: ± 1 dgt. relative to calculation from measured values During fundamental wave calculation: For fundamental frequencies of 45 Hz to 66 Hz $\pm 0.3\%$ rdg. $\pm 0.1\%$ f.s. + current sensor specifications (reactive factor = 1) Reactive factor effects: 1.0% rdg. or less (for input from 40 Hz to 70 Hz with a power factor of 0.5)</p>																																										
Efficiency (Eff)	Measurement method Calculated as the ratio of the active power values for the channel pair. Measurement accuracy: ± 0.1 dgt. relative to calculation from measured values	None																																										
Active energy (WP+, WP-), reactive energy (WQ_LAG, WQ_LEAD), apparent energy (WS)	Energy is measured from the start of recording. Active energy: Calculated separately from the active power for consumption and regeneration. Reactive energy: Integrated separately from the reactive power for lag and lead. Apparent energy: Integrated from the apparent power. *PQ3100 only	Measurement accuracy Active energy: Active power measurement accuracy ± 10 dgt. Reactive energy: Reactive power measurement accuracy ± 10 dgt. Apparent energy: Apparent power measurement accuracy ± 10 dgt. *PQ3100 only Cumulative time accuracy: ± 10 ppm																																										
Energy cost (Ecost)	None	Calculated by multiplying active energy (consumption) (WP+) by the electricity unit cost (/kWh). Measurement accuracy: ± 1 dgt. relative to calculation from measured values																																										
Power factor (PF), displacement power factor (DPF)	Displacement power factor (DPF): Calculated from the fundamental wave active power and reactive power. Power factor: Calculated from the apparent power S and the active power P. Displacement power factor measurement accuracy For input with a voltage of 100 V or greater and current of 10% of the range or greater When displacement power factor = 1: $\pm 0.05\%$ rdg.; when $0.8 \leq$ displacement power factor < 1: $\pm 1.50\%$ rdg.; when $0 <$ displacement power factor < 0.8: $\pm(1 - \cos(\varphi + 0.2865)/\cos(\varphi)) \times 100\%$ rdg. + 50 dgt. (reference value), where φ represents the 1st-order display value for the harmonic voltage-current phase difference Add the current sensor phase accuracy to each.																																											
Demand amount	PQ3198 Can be calculated using PQ ONE.	PQ3100 Energy is measured during each interval. (Values are recorded but not displayed.) Measurement accuracy Active power demand amount (Dem_WP+, Dem_WP-): Active power measurement accuracy ± 10 dgt. Reactive power demand amount (Dem_WQ_LAG, Dem_WQ_LEAD): Reactive power measurement accuracy ± 10 dgt. Apparent power demand amount (Dem_WS): Apparent power measurement accuracy ± 10 dgt. Cumulative time accuracy: ± 10 ppm ± 1 sec. (23°C)																																										
Demand value	Can be calculated using PQ ONE.	Active power demand value (Dem_P+, Dem_P-), reactive power demand value (Dem_Q_LAG, Dem_Q_LEAD), apparent power demand value (Dem_S) Average power values are measured during each interval. Measurement accuracy: ± 1 dgt. relative to calculation from measured values																																										

Power factor demand value measurement specifications (Dem_PF)	N/A	Calculated from the active power demand value (consumption) (Dem_P+) and the reactive power demand value (lag) (Dem_Q_LAG). Measurement accuracy: ± 1 dgt. relative to calculation from measured values	
Unbalance factor	Voltage unbalance factor, reverse-phase unbalance factor (Uunb), zero-phase unbalance factor (Uunb0) For 3-phase/3-wire (3P3W2M, 3P3W3M) and 3-phase/4-wire circuits, calculated using the fundamental voltage component for each of the 3 phases.		
	Measurement accuracy: $\pm 0.15\%$	Defined accuracy: None	
	Current unbalance factor, reverse-phase current unbalance factor (Iunb), zero-phase unbalance factor (Iunb0) For 3-phase/3-wire (3P3W2M, 3P3W3M) and 3-phase/4-wire circuits, calculated using the fundamental current component for each of the 3 phases.		
Measurement specifications	PQ3198		PQ3100
Harmonic voltage (U _{harm}), harmonic current (I _{harm})	Measurement accuracy Voltage 0th order: $\pm 0.3\%$ rdg. $\pm 0.08\%$ f.s. 1st order: $\pm 5\%$ rdg. 2nd to 50th order: $\pm 5\%$ rdg. (for input of at least 1% of the nominal input voltage) Measurement accuracy Current 0th order: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy 1st to 20th order: $\pm 0.5\%$ rdg. $\pm 0.2\%$ f.s. + current sensor accuracy 21st to 50th order: $\pm 1.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy		Measurement accuracy Voltage 0th order: Same as voltage DC value 1st order: Same as voltage RMS value 2nd to 50th order: $\pm 10\%$ rdg. (for input of at least 1% of the nominal input voltage) Measurement accuracy Current 0th order: Same as current DC value 1st to 20th order: $\pm 0.5\%$ rdg. $\pm 0.2\%$ f.s. + current sensor accuracy 21st to 30th order: $\pm 1.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy 31st to 40th order: $\pm 2.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy 41st to 50th order: $\pm 3.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy
Harmonic power (Pharm)	Displays the harmonic power for each channel as well as the sum of values for multiple channels. Measurement accuracy 0th order: $\pm 0.5\%$ rdg. $\pm 0.5\%$ f.s. + current sensor accuracy 1st to 20th order: $\pm 0.5\%$ rdg. $\pm 0.2\%$ f.s. + current sensor accuracy 21st to 30th order: $\pm 1.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy 31st to 40th order: $\pm 2.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy 41st to 50th order: $\pm 3.0\%$ rdg. $\pm 0.3\%$ f.s. + current sensor accuracy		
Harmonic phase angle	Harmonic voltage phase angle (U _{hase}), harmonic current phase angle (I _{hase})		
Harmonic voltage-current phase difference (P _{hase})	Measurement accuracy 1st order: $\pm 1^\circ$ 4th to 50th order: $\pm (0.05^\circ \times k + 2^\circ)$ (k: Harmonic order) 2nd to 3rd order: $\pm 2^\circ$ Add current sensor accuracy to each.		
Inter-harmonic voltage (U _{iharm}), inter-harmonic current (I _{iharm})	Adds and displays the inter-harmonic component between whole number-order harmonic components following harmonic analysis, from the 0.5th to the 49.5th order.		
	Measurement accuracy Inter-harmonic voltage (defined for harmonic input with a nominal input voltage of at least 100 V) Harmonic input of 1% of the nominal input voltage or greater: $\pm 5.0\%$ rdg. Harmonic input of less than 1% of the nominal input voltage: $\pm 0.05\%$ of the nominal input voltage Inter-harmonic current: Accuracy not defined		Measurement accuracy Inter-harmonic voltage (defined for harmonic input with a nominal input voltage of 100 V to 440 V) Harmonic input of 1% of the nominal input voltage or greater: $\pm 10.0\%$ rdg. Harmonic input of less than 1% of the nominal input voltage: $\pm 0.05\%$ of the nominal input voltage Inter-harmonic current: Accuracy not defined
Voltage total harmonic distortion (U _{thd}), current total harmonic distortion (I _{thd})	THD-F: Total harmonic distortion relative to wave THD-F: Total harmonic distortion relative to fundamental wave THD-R: Total harmonic distortion relative to total harmonics, including fundamental wave THD-R: Total harmonic distortion relative to total harmonics, including fundamental wave Measurement accuracy: 0.5% Defined for input as follows for a nominal input voltage of 100 V to 440 V: Voltage 1st order: 100% of nominal input voltage / 5th and 7th orders: 1% of nominal input voltage Current 1st order: 100% of current range / 5th and 7th orders: 1% of current range		
High-order harmonic voltage component (U _{harmH}), high-order harmonic current component (I _{harmH})	PQ3198		PQ3100
	Measurement method Calculated using the true RMS method and the waveform obtained by eliminating the fundamental wave component from 10 waves (for a 50 Hz fundamental wave) or 12 waves (for a 60 Hz fundamental wave). Sampling frequency: 200 kHz Display parameters High-order harmonic voltage component value: Voltage RMS value for the waveform obtained by eliminating the fundamental wave component High-order harmonic current component value: Current RMS value for the waveform obtained by eliminating the fundamental wave component High-order harmonic voltage maximum value: Maximum RMS value for the voltage waveform obtained by eliminating the fundamental wave component for the interval extending from event IN to event OUT (leaving channel information) High-order harmonic current maximum value: Maximum RMS value for the current waveform obtained by eliminating the fundamental wave component for the interval extending from event IN to event OUT (leaving channel information) High-order harmonic voltage component interval: Interval extending from high-order harmonic voltage component event IN to event OUT High-order harmonic current component interval: Interval extending from high-order harmonic current component event IN to event OUT Measurement band: 2 kHz to 80 kHz (-3 dB) Measurement accuracy High-order harmonic voltage component: $\pm 10\%$ rdg. $\pm 0.1\%$ f.s. (defined for a 10 V sine wave at 5 kHz, 10 kHz, and 20 kHz) High-order harmonic current component: $\pm 10\%$ rdg. $\pm 0.2\%$ f.s. (defined for a 1% f.s. sine wave at 5 kHz, 10 kHz, and 20 kHz) Saved waveforms Event waveform, high-order harmonic waveform (8000 points of data over 40 ms starting after the first 200 ms aggregate to exceed the threshold)		N/A

K factor (zoom factor) (KF)	Calculated using the harmonic current RMS values for the 2nd to 50th orders.			
Instantaneous flicker value measurement (Pinst)	Measurement method As per IEC 61000-4-15			
IEC flicker (Pst-Plt)	Pst is calculated after measuring continuously for 10 min., while Plt is calculated after measuring continuously for 2 hours, as per IEC 61000-4-15. Measurement accuracy: Pst: $\pm 5\%$ rdg. (defined as Class F1 [PQ3198] or Class F3 [PQ3100] performance testing under IEC 61000-4-15)			
ΔV_{10} flicker (dV10)	Values calculated using the flicker visibility function curve are converted to 100 V and measured in a gap-less manner every minute. ΔV_{10} 1-minute values, 1-hour average value, 1-hour maximum value, 1-hour 4th largest value, overall maximum value (during measurement interval) Measurement accuracy: $\pm 2\%$ rdg. ± 0.01 V (with a fundamental wave of 100 Vrms [50/60 Hz], a fluctuation voltage of 1 Vrms [99.5 Vrms to 100.5 Vrms], and a fluctuation frequency of 10 Hz) Alarm: Set from 0.00 to 9.99 V to generate contact output if the threshold value is exceeded during any given minute.			
RMS value frequency characteristics	Frequency	Voltage	Current	Power
	40 Hz to 70 Hz	Defined by RMS value	Defined by RMS value	Defined by RMS value
	70 Hz to 360 Hz	$\pm 1\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 1\%$ rdg. $\pm 0.5\%$ f.s.	$\pm 1\%$ rdg. $\pm 0.5\%$ f.s.
	360 Hz to 440 Hz	Defined by RMS value	Defined by RMS value	Defined by RMS value
	440 Hz to 5 kHz	$\pm 5\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 5\%$ rdg. $\pm 0.5\%$ f.s.	$\pm 5\%$ rdg. $\pm 1\%$ f.s.
	5 kHz to 20 kHz	$\pm 5\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 5\%$ rdg. $\pm 0.5\%$ f.s.	$\pm 5\%$ rdg. $\pm 1\%$ f.s.
	20 kHz to 50 kHz	$\pm 20\%$ rdg. $\pm 0.4\%$ f.s.	$\pm 20\%$ rdg. $\pm 0.5\%$ f.s.	
	80 kHz	-3 dB	-3 dB	
	Frequency	Voltage	Current	Power
	40 Hz to 70 Hz	Defined by RMS value	Defined by RMS value	Defined by active power
	70 Hz to 1 kHz	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.
	1 kHz to 10 kHz	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.
	40 kHz	-3 dB	-3 dB	

Measurement settings	
Current sensor and current range	See current sensor specifications.
Power range	Determined automatically based on the current range being used.
Ratio, CT ratio	0.01 to 9999.99
Nominal input voltage	50 V to 780 V in 1 V increments
Frequency	50 Hz / 60 Hz / 400 Hz
Selection of calculation method	Urms: Phase voltage / Line voltage Power factor: PF / DPF THD: THD-F / THD-R Harmonics: All levels / All content percentages / Content percentages for U and P, levels for I
Energy cost	N/A
Flicker	Pst, Plt / ΔV_{10}
Filter	Select Pst or Plt for flicker. 230 V lamp / 120 V lamp

Recording settings	PQ3198	PQ3100
Recording interval	1/3/15/30 sec., 1/5/10/15/30 min., 1/2 hr., 150 (50 Hz)/180 (60 Hz)/1200 (400 Hz) cycle	200/600 ms, 1/2/5/10/15/30 sec., 1/2/5/10/15/30 min., 1/2 hr., 150/180 cycle *When set to 200/600 ms, harmonic data saving (except total harmonic distortion and K factor), event recording, and copy key operation during recording are not available.
Saving of screenshots	Off/On The display screen is saved as a BMP file for each recording interval. Min. interval: 5 min.	
Folder/file names	Not user-configurable	Set to either automatic or user-specified (5 single-byte characters).




Event specifications	
Event detection method	The detection method for measured values for each event is noted in the measurement specifications. External events: Events are detected by detecting a signal input to the EVENT IN terminal. Manual events: Events are detected based on operation of the MANUAL EVENT key.
Synchronized saving of events	Event waveforms: A 200 ms instantaneous waveform is recorded when an event occurs. Transient waveform: Instantaneous waveforms are recorded for 2 ms before the transient voltage waveform detection point and for 2 ms after the detection point. Fluctuation data: RMS value fluctuation data is recorded every half-wave for the equivalent of 0.5 sec. before the event occurs and 29.5 sec. after the event occurs. High-order harmonic waveform: A 40 ms instantaneous waveform is recorded when a high-order harmonic event occurs.




Event settings	
Event hysteresis	0% to 100%
Timer event count	Off, 1/5/10/30 min., 1/2 hr. Events are generated at the selected interval.
Waveforms before events	2 waves Off (0 sec.) / 200 ms / 1 sec. The time for which to record instantaneous waveforms before events occur can be set.
Waveforms after events	Successive events: Off/1/2/3/4/5 The set number of events is repeated each time an event occurs. Off (0 sec.)/200 ms/400 ms/1 sec./5 sec./10 sec. The time for which to record instantaneous waveforms after events occur can be set.




Other functionality	
Copying of screenshots	Copy using the COPY key; results are saved to the SD card. Data format: Compressed BMP
Removal of SD card while recording data	Not supported A message is displayed if the user pressed the F key on the FILE screen while recording with a recording interval of 2 sec. or greater; the SD card can be removed once message is reviewed.
Automatic detection of current sensors	When selected on the settings screen, connected sensors that support the HIOKI PL 14 connector are automatically detected.
Processing in the event of a power outage	If the instrument is equipped with a BATTERY PACK Z1003 with a remaining charge, the instrument will switch automatically to battery power and continue recording. If no charged BATTERY PACK Z1003 is installed, measurement will stop (settings will be preserved), and the instrument will start recording again when power is restored. However, integrated values and other data will be reset.



Interfaces		
SD memory card	Compatible cards: Z4001, Z4003	
LAN	Remote operation via an Internet browser Manual downloading of data via the FTP server function	Remote operation via an Internet browser Manual downloading of data via the FTP server function Automatic transmission of data via the FTP client function Email notifications
USB	USB 2.0 (Full Speed, High Speed), Mass Storage Class	
RS-232C	Synchronization of clock with GPS (when using GPS BOX PW9005)	Acquisition of measurement and settings data via communications commands LR8410 Link support
External control	4 screwless terminals External event input, external start/stop, external event output (non-isolated), ΔV10 alarm	4 screwless terminals External event input, external event output (isolated), ΔV10 alarm
General specifications		
Operating location	Indoor use, Pollution Level 2, elevations of up to 3000 m (Measurement category is reduced to CAT III [600 V] at elevations in excess of 2000 m [6561.68 ft].)	Indoor use, Pollution Level 2, elevations of up to 3000 m (Measurement category is reduced to CAT II [1000 V] or CAT III [600 V] at elevations in excess of 2000 m [6561.68 ft].)
Operating temperature and humidity range	0°C to 30°C, 95% RH or less (non-condensing) 30°C to 50°C, 80% RH or less (non-condensing)	-20°C to 50°C, 80% RH or less (non-condensing)
Storage temperature and humidity range	10°C greater than operating temperature and humidity range	
Dustproofness and waterproofness	IP30 (EN 60529)	
Standard compliance	Safety: EN 61010 EMC: EN 61326 Class A	
Standard compliance	Harmonics: IEC 61000-4-7, IEC 61000-2-4 Class 3 Power quality: IEC 61000-4-30, EN 50160, IEEE 1159 Flicker: IEC 61000-4-15	
Power supply	AC ADAPTER Z1002 100 V to 240 V AC, 50 Hz/60 Hz; anticipated transient overvoltage: 2500 V; maximum rated power: 80 VA (including AC adapter) BATTERY PACK Z1003 Charging time: Max. 5 hr. 30 min.	
	Continuous battery operating time: About 3 hr.	Continuous battery operating time: About 8 hr.
Internal memory	N/A	4 MB
Maximum recording time	1 year	
Maximum number of recordable events	9999	
Time functions	Auto-calendar, automatic leap year detection, 24-hour clock	
Real time accuracy	Within ±0.3 sec./day (with instrument powered on at 23°C ±5°C)	Within ±0.5 sec./day (with instrument powered on and within operating temperature range)
Display	6.5-inch TFT color LCD	
Display languages	English / Japanese / Chinese (simplified and traditional) / Korean / German / French / Italian / Spanish / Turkish / Polish	
External dimensions	300 mm (11.81 in.) (W) × 211 mm (8.31 in.) (H) × 68 mm (2.68 in.) (D) (not including protruding parts)	
Weight	2.6 kg (91.7 oz) (including BATTERY PACK Z1003)	2.5 kg (88.2 oz) (including BATTERY PACK Z1003)

Options [*1] PQ3198 only. [*2] PQ3100 only.

Model	AC CURRENT SENSOR CT7126	AC CURRENT SENSOR CT7131	AC CURRENT SENSOR CT7136
Appearance			
Rated measured current	60 A AC	100 A AC	600 A AC
Measurable wire diameter	15 mm (0.59 in.) or less		46 mm (1.81 in.) or less
Current range and combined amplitude accuracy (45 to 66 Hz) *Accuracy guaranteed up to 120% of range.	Current range Combined accuracy 50.000 A 0.4% rdg. + 0.112% f.s. 5.0000 A 0.4% rdg. + 0.22% f.s. 500.00 mA 0.4% rdg. + 1.3% f.s. [*2]	Current range Combined accuracy 100.00 A 0.4% rdg. + 0.12% f.s. 50.000 A 0.4% rdg. + 0.14% f.s. 5.0000 A 0.4% rdg. + 0.50% f.s. [*2]	Current range Combined accuracy 500.00 A 0.4% rdg. + 0.112% f.s. 50.000 A 0.4% rdg. + 0.22% f.s. 5.0000 A 0.4% rdg. + 1.3% f.s. [*2]
Phase accuracy (45 to 66 Hz)	Within $\pm 2^\circ$	Within $\pm 1^\circ$	Within $\pm 0.5^\circ$
Maximum allowable input (45 to 66 Hz)	60 A continuous	130 A continuous	600 A continuous
Maximum rated terminal-to-ground voltage	CAT III (300 V)		CAT III (1000 V), CAT IV (600 V)
Frequency band	Accuracy defined up to 20 kHz		
Dimensions / weight / cord length	46 mm (1.81 in.) (W) \times 135 mm (5.31 in.) (H) \times 21 mm (0.83 in.) (D) / 190 g / 2.5 m (8.20 ft.)		78 mm (3.07 in.) (W) \times 152 mm (5.98 in.) (H) \times 42 mm (1.65 in.) (D) / 350 g / 2.5 m (8.20 ft.)

Model	AC FLEXIBLE CURRENT SENSOR CT7044	AC FLEXIBLE CURRENT SENSOR CT7045	AC FLEXIBLE CURRENT SENSOR CT7046
Appearance			
Rated measured current	6000 A AC		
Measurable wire diameter	100 mm (3.94 in.) or less	180 mm (7.09 in.) or less	254 mm (10.00 in.) or less
Current range and combined amplitude accuracy (45 to 66 Hz) *Accuracy guaranteed up to 120% of range.	Current range 5000.0 A/500.00 A 50.000 A		Combined amplitude accuracy 1.6% rdg. + 0.4% f.s. 1.6% rdg. + 3.1% f.s.
Phase accuracy (45 to 66 Hz)	Within $\pm 1.0^\circ$		
Maximum allowable input (45 to 66 Hz)	10,000 A continuous		
Maximum rated terminal-to-ground voltage	1000 V AC (CAT III), 600 V AC (CAT IV)		
Frequency band	10 Hz to 50 kHz (within ± 3 dB)		
Dimensions / cord length	Flexible loop cross-sectional diameter: 7.4 mm (0.29 in.) / 2.5 m (8.20 ft.)		
Weight	160 g	180 g	190 g

Model	AC/DC AUTO-ZERO CURRENT SENSOR CT7731	AC/DC AUTO-ZERO CURRENT SENSOR CT7736	AC/DC AUTO-ZERO CURRENT SENSOR CT7742
Appearance			
Rated measured current	100 A AC/DC	600 A AC/DC	2000 A AC/DC
Measurable wire diameter	33 mm (1.30 in.) or less		55 mm (2.17 in.) or less
Current range and combined amplitude accuracy *Accuracy guaranteed up to 120% of range.	DC	Current range Combined accuracy 100.00 A 1.5% rdg. + 1.0% f.s. 50.000 A 1.5% rdg. + 1.5% f.s. [*1] 10.000 A 1.5% rdg. + 5.5% f.s. [*2]	Current range Combined accuracy 500.00 A 2.5% rdg. + 1.1% f.s. 50.000 A 2.5% rdg. + 6.5% f.s.
	45 to 66 Hz	100.00 A 1.1% rdg. + 0.6% f.s. 50.000 A 1.1% rdg. + 1.1% f.s. [*1] 10.000 A 1.1% rdg. + 5.1% f.s. [*2]	500.00 A 2.1% rdg. + 0.7% f.s. 50.000 A 2.1% rdg. + 6.1% f.s.
Phase accuracy (45 to 66 Hz)	Within $\pm 1.8^\circ$		Within $\pm 2.3^\circ$
Offset drift	Within $\pm 0.5\%$ f.s.	Within $\pm 0.1\%$ f.s.	Within $\pm 0.1\%$ f.s.
Maximum allowable input (45 to 66 Hz)	100 A continuous	600 A continuous	2000 A continuous
Maximum rated terminal-to-ground voltage	600 V AC/DC (CAT IV)	1000 V AC/DC (CAT III), 600 V AC/DC (CAT IV)	
Frequency band	DC to 5 kHz (-3 dB)		
Dimensions / weight / cord length	58 mm (2.28 in.) (W) \times 132 mm (5.20 in.) (H) \times 18 mm (0.51 in.) (D) / 250 g / 2.5 m (8.20 ft.)	64 mm (2.52 in.) (W) \times 160 mm (6.30 in.) (H) \times 34 mm (1.34 in.) (D) / 320 g / 2.5 m (8.20 ft.)	64 mm (2.52 in.) (W) \times 195 mm (7.68 in.) (H) \times 34 mm (1.34 in.) (D) / 510 g / 2.5 m (8.20 ft.)

Model	AC LEAK CURRENT SENSOR CT7116	
Appearance	Designed specifically for leak current measurement  	
Rated measured current	6 A AC	
Measurable conductor diameter	40 mm or less (insulated conductor)	
Current range and combined amplitude accuracy (45 to 66 Hz)	Current range 5.0000 A 500.00 mA 50.000 mA	Combined accuracy 1.1% rdg. + 0.16% f.s. 1.1% rdg. + 0.7% f.s. 1.1% rdg. + 6.1% f.s. [*2]
Phase accuracy (45 to 66 Hz)	Within $\pm 3^\circ$	
Frequency band	40 Hz to 5 kHz ($\pm 3.0\%$ rdg. $\pm 0.1\%$ f.s.)	
Residual current characteristics	5 mA or less (for a pair of round-trip wires carrying 100 A)	
External magnetic field effects	5 mA equivalent, max. 7.5 mA (400 A/m, 50/60 Hz)	
Dimensions / weight / cord length	74 mm (2.91 in.) (W) \times 145 mm (5.71 in.) (H) \times 42 mm (1.65 in.) (D) / 340 g / 2.5 m (8.20 ft.)	

Option for connecting legacy current sensor models



CONVERSION CABLE L9910

Output connector conversion:
BNC \rightarrow PL 14

Use by connecting to one of the following legacy sensor models:

CLAMP ON SENSOR 9694/9660/9661/9669

AC FLEXIBLE CURRENT SENSOR CT9667-01/CT9667-02/CT9667-03
*Conversion cable does not supply power to the sensor.

CLAMP ON LEAK SENSOR 9657-10/9675

Current sensor options



EXTENSION CABLE L0220-01
2 m (6.56 ft.)

EXTENSION CABLE L0220-02
5 m (16.50 ft.)

EXTENSION CABLE L0220-03
10 m (32.81 ft.)

Voltage measurement options

HIOKI provides quotations for voltage cord extensions, terminal connector conversions, and other options on a case-by-case basis. Please contact your HIOKI distributor for details.



MAGNETIC ADAPTER 9804-01

Alternative tip for the L1000 series voltage cords, red \times 1, ϕ 11 mm (0.43 in)

MAGNETIC ADAPTER 9804-02

Alternative tip for the L1000 series voltage cords, black \times 1, ϕ 11 mm (0.43 in)

GRABBER CLIP L9243

Alternative tips for the L1000 series voltage cords

OUTLET TEST LEAD L1020

For Japan (3-prong, P/N/E), 2 m (6.56 ft) length,

*Please contact HIOKI for cords for use in countries other than Japan.

PATCH CORD L1021-01

Banana branch-banana, Red: 1, 0.5 m (1.64 ft) length, for branching from the L9438s or L1000s, CAT IV 600 V, CAT III 1000 V

PATCH CORD L1021-02

Banana branch-banana, Black: 1, 0.5 m (1.64 ft) length, for branching from the L9438s or L1000s, CAT IV 600 V, CAT III 1000 V

Magnetic straps



MAGNETIC STRAP Z5004

MAGNETIC STRAP Z5020
Extra strength

Interfaces



SD MEMORY CARD
2GB Z4001
2 GB capacity



SD MEMORY CARD
Z4003
8 GB capacity



RS-232C CABLE
9637
9 pin - 9 pin, cross,
1.8 m (5.91 ft) length



LAN CABLE 9642
Straight Ethernet cable,
supplied with straight to
cross conversion adapter,
5 m (16.41 ft) length

About SD memory cards

Be sure to use genuine HIOKI SD memory cards with HIOKI instruments. Use of other SD memory cards may prevent data from being properly saved or loaded as proper operation is not guaranteed.

Carrying cases and waterproof boxes



CARRYING CASE
C1009
Bag type, Includes
compartment for options



CARRYING CASE
C1001
Soft type, Includes
compartment for options



CARRYING CASE
C1002
Hard trunk type, Includes
compartment for options



Waterproof box
For outdoor
installation, IP65

PQ3198 options



WIRING ADAPTER PW9000

When three-phase 3-wire connection, the voltage cord to be connected can be reduced from 6 to 3



WIRING ADAPTER PW9001

When three-phase 4-wire connection, the voltage cord to be connected can be reduced from 6 to 4



GPS BOX PW9005

To synchronize the PQ3198 / PW3198 clock to UTC

Standard accessories (also available for separate purchase)



Comes with the PQ3198

VOLTAGE CORD L1000
Red/ Yellow/ Blue/ Gray each 1,
Black 4, 3m (9.84ft) length,
Alligator clip \times 8



Comes with the PQ3100

VOLTAGE CORD L1000-05
Red/ Yellow/ Blue/ Gray/ Black
each 1, 3 m (9.84 ft) length,
Alligator clip \times 5



AC ADAPTER Z1002
For main unit, 100 to 240
V AC



BATTERY PACK
Z1003
NiMH, Charges while
installed in the main unit

Models

Product name **POWER QUALITY ANALYZER PQ3198**

Model (order code)	PQ3198	PQ3198-92	PQ3198-94
Bundle contents	 <p>POWER QUALITY ANALYZER PQ3198</p> <p>VOLTAGE CORD L1000 Color clips Measurement guide AC ADAPTER Z1002 Spiral tubes PQ ONE (software CD) BATTERY PACK Z1003 Strap SD MEMORY CARD Z4001 USB cable User manual</p>		
	—	 <p>AC CURRENT SENSOR CT7136 (x4)</p>	 <p>AC FLEXIBLE CURRENT SENSOR CT7045 (x4)</p>
	—	 <p>CARRYING CASE C1009 PATCH CORD L1021-02 (x3)</p>	

Product name **POWER QUALITY ANALYZER PQ3100**

Model (order code)	PQ3100	PQ3100-91	PQ3100-92	PQ3100-94
Bundle contents	 <p>POWER QUALITY ANALYZER PQ3100</p> <p>VOLTAGE CORD L1000-05 Color clips Measurement guide AC ADAPTER Z1002 Spiral tubes PQ ONE (software CD) BATTERY PACK Z1003 Strap User manual USB cable User manual</p>			
	—	 <p>AC CURRENT SENSOR CT7136 (x2)</p>	 <p>AC CURRENT SENSOR CT7136 (x4)</p>	 <p>AC FLEXIBLE CURRENT SENSOR CT7045 (x4)</p>
	—	 <p>CARRYING CASE C1009 SD MEMORY CARD Z4001</p>		

Related products

No-metal-contact voltage sensor




Check power quality with a no-metal-contact logger

CLAMP ON POWER LOGGER PW3365-20

- Record maximum, minimum, average, and energy values by time interval for parameters including voltage, current, power, frequency, and harmonics.

For details



New, more easily clampable design




Clamp meters designed for exceptional ease of use

CLAMP METER CM4376, CM4142

- Ascertain transient current when power equipment starts up.
- Simultaneously measure RMS values and maximum crest values for inrush current.

For details



+982165565901

+982144584619

+989034119385

پتروفهران گستر جنوب

FGJ-NDT.IR

DIGINDT.IR